

TAHOE CITY PUBLIC UTILITY DISTRICT
Water Service with Fire Sprinkler System

FORM F

- New Construction Remodel/Addition Tear Down/Rebuild
- Other _____

Property Address _____ APN _____
Owner Name _____
Owner Phone No. _____ Subdivision _____ Unit / Lot _____
E-mail: _____
Applicant Name _____ Phone No. _____ E-mail _____

CONSTRUCTION DETAILS Single Family Residence Multiple Residential, No. of Units _____

Existing Square Footage _____ New TOTAL Square Footage _____

Information from District:

Is there an existing water service on the Property? Y N If Yes, meter size on file? _____ District Stub size?* _____

If stub size is unknown, fire sprinkler designer must assume it to be 3/4" or pay for District to inspect the stub.

District Stub size inspection (pothole) with \$400 Fee for time and materials Y N

District Pressure Review (check one)

Static Pressure \$75 or **Hydrant Flow \$255** Paid Y N or **Declined Pressure Test**

Fire Sprinkler Contractor _____ Phone No. _____

Will you install a new fire sprinkler service? Y N **Size** _____ **Material** _____

Will you install a new fire sprinkler holding tank? Y N Will the tank supply line be hard plumbed? Y N

Will you expand an existing fire sprinkler system? Y N Existing Size _____ Existing Material _____

New Size _____ New Material _____

Will this property be abandoning an existing water stub for a new water stub? Y N

LOCAL FIRE DISTRICT APPROVAL: TO BE COMPLETED BY THE LOCAL FIRE DISTRICT OR THE EL DORADO COUNTY BUILDING DEPARTMENT ONLY!

- This project is exempt from the fire sprinkler system requirements (under square footage thresholds).
- The fire sprinkler system and fire service information listed above has been reviewed and approved.
- This property has an existing fire sprinkler system which will be expanded for the proposed project.

Fire District/Building Department Authorized Signature/Stamp:

As an alternative to preparing the fire sprinkler plans at this time, the fire sprinkler contractor may prepare a letter to the local fire district (or El Dorado County Building Dept.), stating the basics of the proposed fire sprinkler system (e.g. size of water lateral from main to meter, meter size, size of water lateral from meter to house, if a booster pump is needed, and if a holding tank will be installed, etc.). This letter shall then be stamped and signed by the Fire District or Building Department. **See attached letter**

Authorized Representative Statement

I have personally examined and am familiar with the information submitted from the Fire Sprinkler Contractor in the attached Calculation Application, and I hereby certify that this information is true, accurate and complete.


Applicant Name (print)

Applicant Title

Applicant Signature

Date

Customer's Domestic Water and Fire Line Configuration Preference
Please Circle One (1)

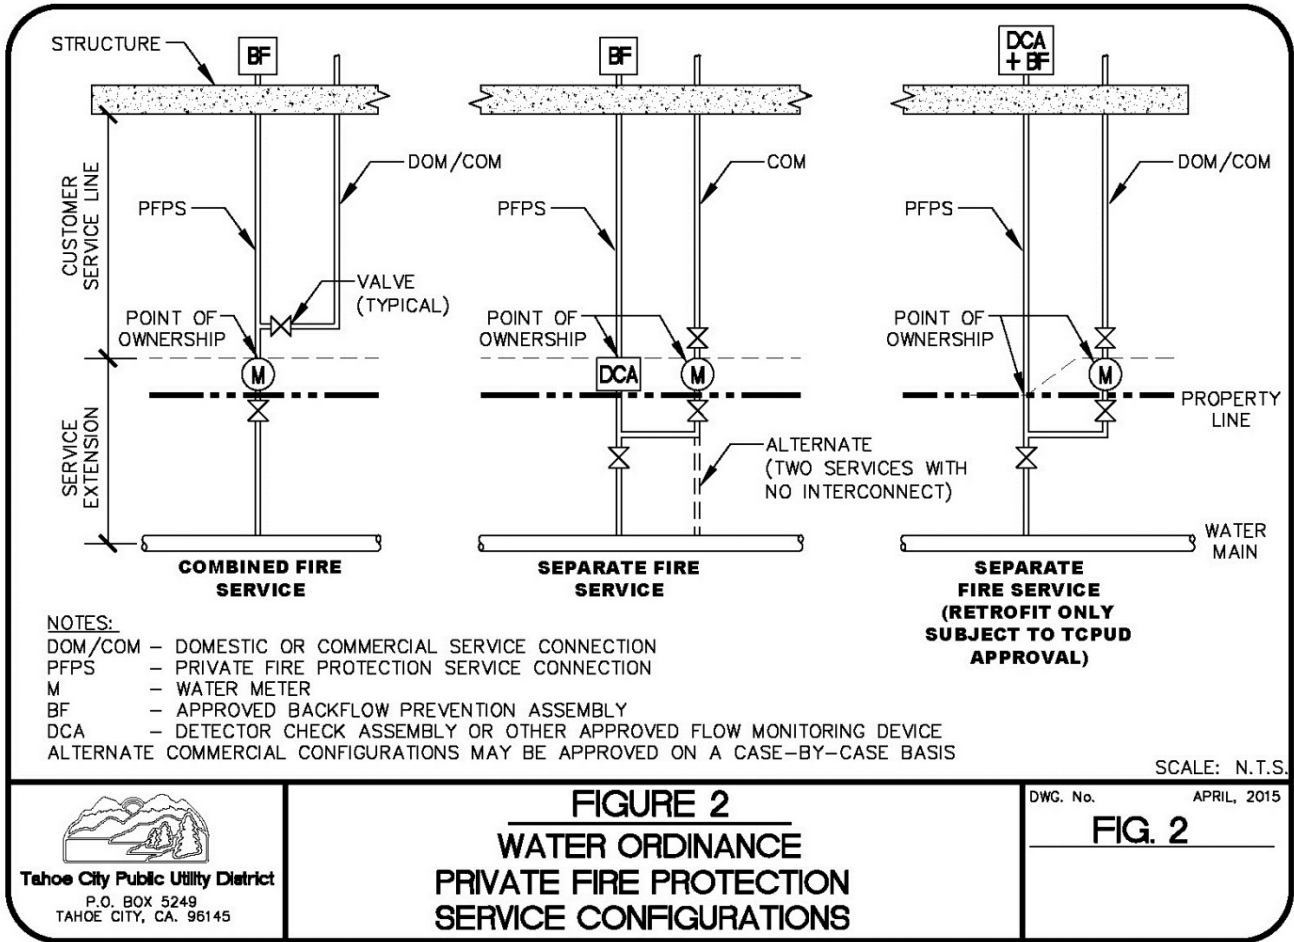

Please Choose One:

Combined Service Size (at Meter)	Service Classification	Connection Fees*	Monthly Base Rate*
3/4"	3/4" domestic	\$2,500.00	\$ 62.50
	3/4" fire	\$1,200.00	\$ 23.63
	TOTAL	\$3,700.00	\$ 86.10
1"	3/4" domestic	\$2,500.00	\$ 62.50
	1" fire	\$1,200.00	\$ 31.50
	TOTAL	\$3,700.00	\$ 94.00
1.5"	1" domestic	\$3,000.00	\$ 94.25
	1.5" fire	\$1,200.00	\$ 47.15
	TOTAL	\$4,200.00	\$141.40
2"	1" domestic	\$3,000.00	\$ 94.25
	2" fire	\$1,200.00	\$ 63.00
	TOTAL	\$4,200.00	\$157.15

* According to residential Rate Structure effective January 1, 2015

Customer to choose which Combined Service Size they want the **TCPUD** to install

Check ONE (1) Option

District Work Order to Utilities # _____ for \$ _____ **quote** to install the water meter configuration.
Completed District **Quote** Returned to Compliance Services. Date: _____ and copy attached Y N